


Fluoride in Public Drinking Water Supplies of Alabama in 2020



ORAL HEALTH OFFICE
Promoting Smiles Across a Lifetime

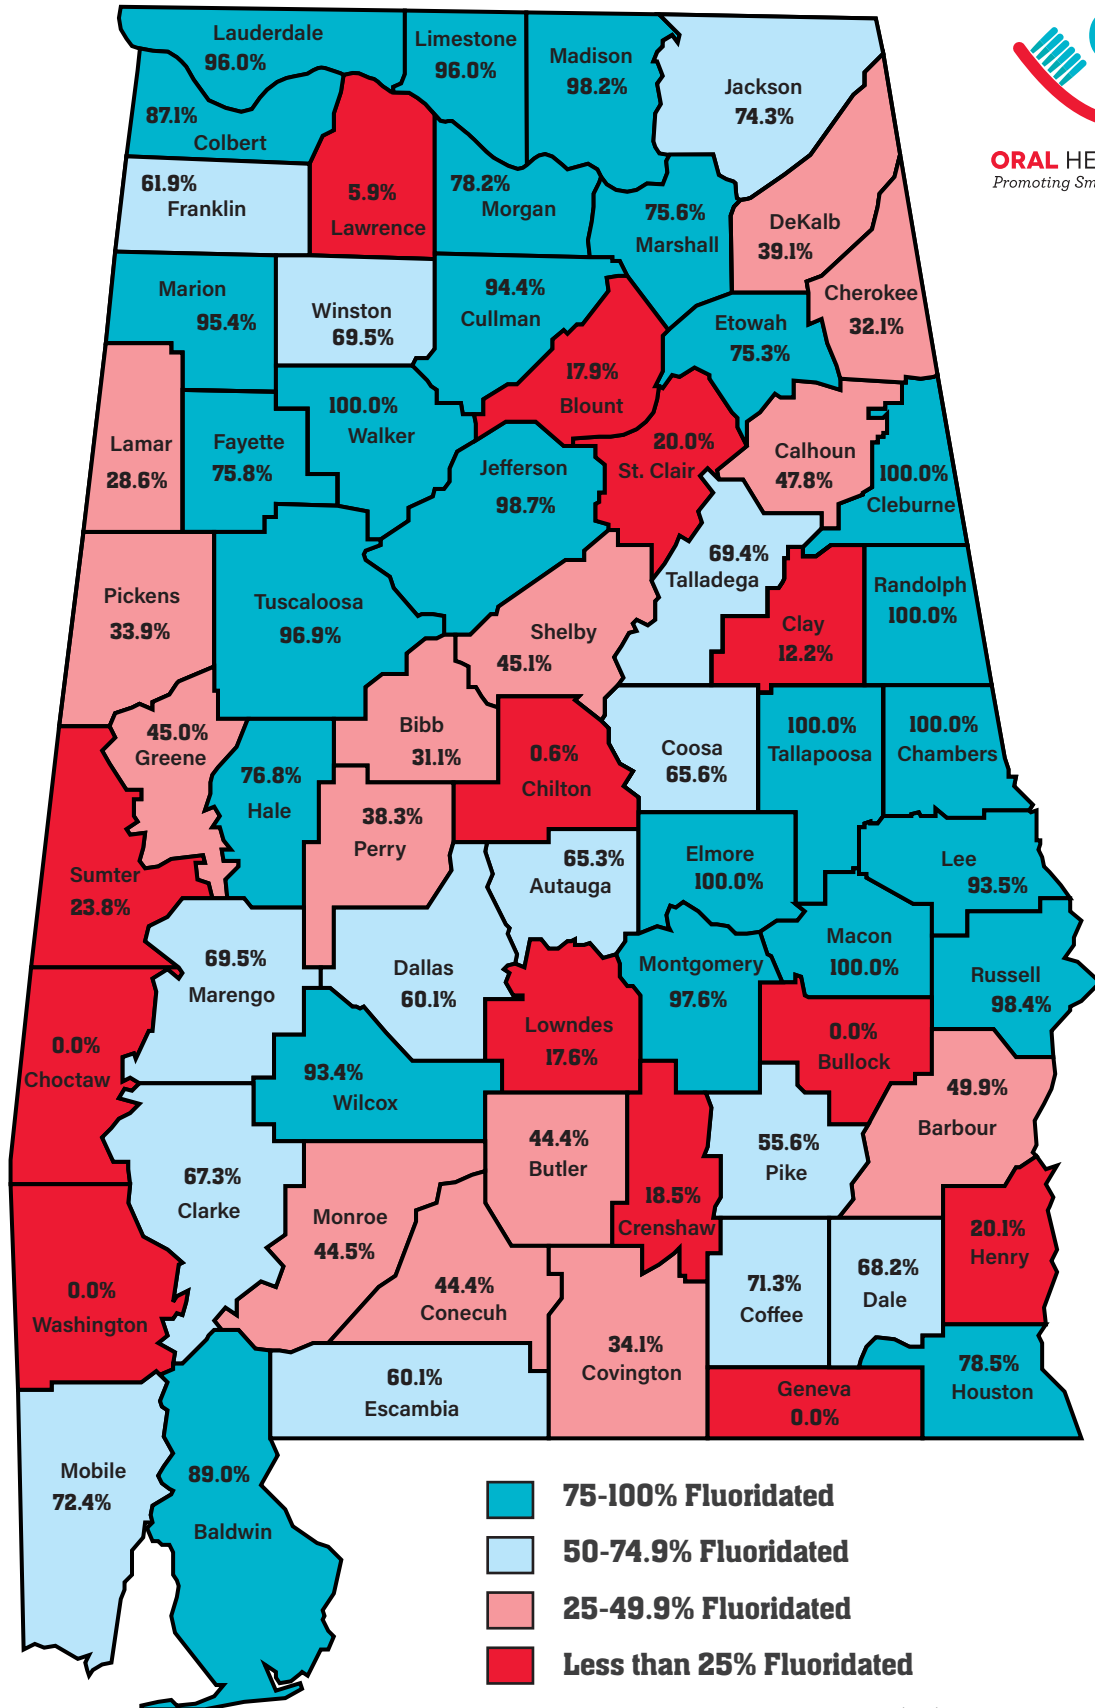

- 75-100% Fluoridated
- 50-74.9% Fluoridated
- 25-49.9% Fluoridated
- Less than 25% Fluoridated



Data provided by 2019-2020 Centers for Disease Control (CDC) Water FL Reporting System (WFRS).

Populations on public water systems may exceed the county census population. Many water systems span multiple counties. WFRS collects population data for primary and secondary counties for each water system. However, due to difficulty in assigning population values to multiple counties, the primary county information can be over-estimated.

September 2023